



Dimmers

BES- DM490140

Programming manual



Index

1	GENERAL DESCRIPTION	3
2	TECHNICAL INFORMATION	4
3	PROGRAMMING	5
3.1	APPLICATION PROGRAM INFORMATION	5
3.2	INDIVIDUAL ADDRESS ASSIGNMENT	5
3.3	COMMUNICATION OBJECTS	6
3.4	OBJECTS DESCRIPTION	6
3.5	PARAMETERS.....	8
3.5.1	<i>General</i>	9
3.5.2	<i>Channel 1/2/3</i>	9
3.5.3	<i>Scenes</i>	10
3.6	INPUTS	11
3.6.1	<i>Connection</i>	11
3.6.2	<i>Working mode</i>	12
4	APPLICATION NOTES	13
4.1	LIGHT CONTROL WITH SCENES	13
4.1.1	<i>Devices</i>	13
4.1.2	<i>Description</i>	13
4.1.3	<i>Objects links</i>	13
4.1.4	<i>Parameter settings</i>	14
5	INSTALLATION	15

1 General description

The DM490140 is a one channel dimmer which allows to regulate general Led strip modules or any other low voltage lamp up to 1000W.

Designed to obtain a precise digital regulation receiving orders through the bus or from a pushbutton connected to its low voltage input by using long/short pulsations.

The regulating ramp speed (the progressive on/off lighting) can be configured by programming.



Characteristics:

- 1 Regulation channels.
- Applicable power per channel depending on the load:
- Output power 1000W
- 1 low voltage input (SELV) for pushbuttons (non-programmable).
- 8 Programmable scenes that can be executed from bus commands.
- Remote enable / disable of bus control.
- Overload circuit protection.
- Digital regulation control based on microcontroller with more than 250 regulation points.

2 Technical information

Voltage Supply	230Vac
Max. Power consumption	0,5W @ 230Vac
KNX Supply	29Vdc from KNX BUS
BUS current consumption	5mA from KNX BUS
Mounting	DIN rail
Size	4 DIN modules
Connections	Connection to KNX BUS Screw terminal blocks for power , inputs and outputs
Outputs	1 dimmer channel
Output power	1000W
Inputs	1 low-voltage input (SELV) with intern reference.
Drive current inputs	Mín. 15mA
Cable distance to the inputs	Max. 30 m (from the input mechanism)
Temperature range	- Running: -10°C a 55°C - Storage: -30°C a 60°C - Transport: -30°C a 60°C.
Regulation	According to the directives of electro magnetic compatibility and low voltage: EN 100090-2-2 / UNE-EN 61000-6-3:2007 / UNE-EN 61000-6-1:2007 / UNE-EN 61010-1.EN 100090-2-2 / UNE-EN 61000-6-3:2007 / UNE-EN 61000-6-1:2007 / UNE-EN 61010-1.

3 Programming

3.1 Application program information

Application program: Ingenium / Dimmers (manufacturer / program name).


Dynamic objects table generation: yes.

Catalogue version: v2.1.2

Maximum number of communication objects: 24.

Maximum number of assignments: 25.

The parameters of the device are configured with a specific parameter dialog; do click on the link “open” from the parameters menu in the ETS to run it.

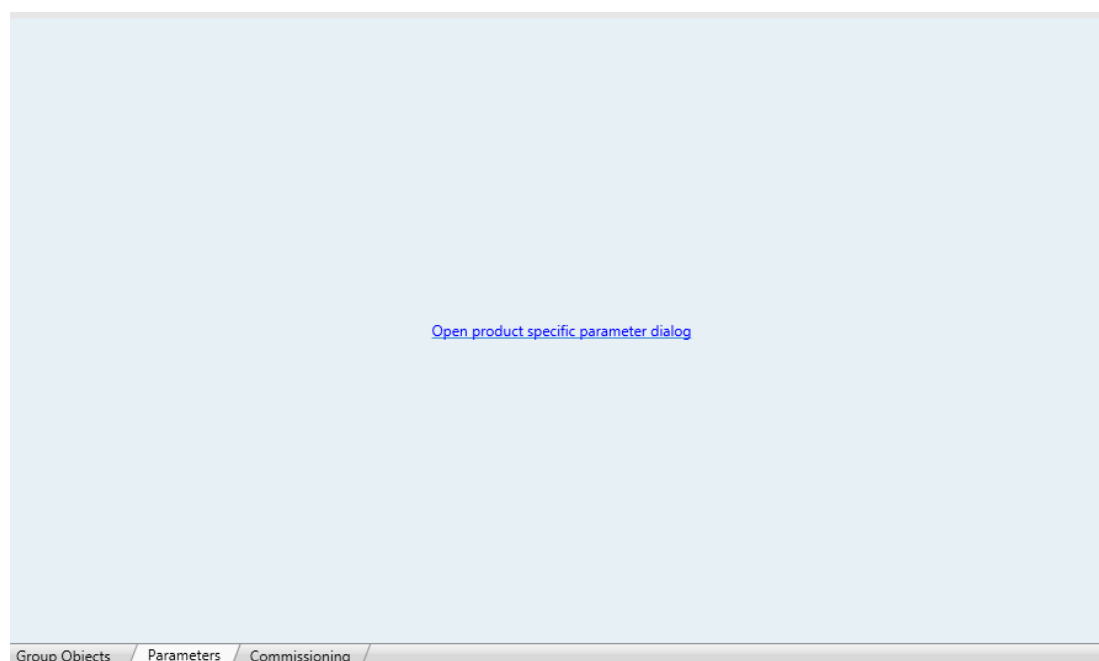

3.2 Individual address assignment

This dimmer has a programming button for the KNX individual address assignment which is located on the front of the device.

A red led near the programming button lights up when it is pressed manually or if the device is set remotely to programming mode state.

The led is automatically turned off if the ETS has assigned an individual address correctly or if the programming button is pressed again manually.

3.3 Communication objects

Number of communication objects: 7.

Number of assignments: 24.

Objeto	Nombre / Función	Longitud	DPT	Flags				
				C	R	W	T	U
0	CH1 - On/Off	1 bit	1.001	•		•	•	
1	CH1 - Dimmer	4 bit	3.007	•		•	•	
2	CH1 - Value	1 byte	5.001	•		•	•	
3	CH1 - On/Off status	1 bit	1.001	•	•	•	•	•
4	CH1 - Value status	1 byte	5.001	•	•		•	•
21	DMDM490140- Enable	1 bit	1.001	•	•	•	•	
22	Scene	1 byte	5.001	•		•	•	

3.4 Objects description

Name	Object 0: CH1 - On/Off
Function	1 bit communication object to switch on and off the regulation channel 1.
Description	<p>When a "1" is received through this object the dimmer is switched on and the brightness level goes up to the last regulation value (non-zero).</p> <p>When a "0" is received the dimmer is switched off.</p> <p>By default, the behavior of light when it is turned on through this subject is to take the value it had before switching off.</p>
Name	Object 1: CH1 - Dimmer
Function	4 bits communication object for dimming control with pushbuttons.
Description	<p>Depending on the dimming steps set in the pushbutton, telegrams will make the brightness level goes up or down according to the ramp speed configured.</p> <p>Breaks telegrams to this object will stop the brightness at the current level.</p> <p>By default, the behavior when receiving a telegram to increase the brightness when the light is turned off is turned on and start to regulate. Conversely, if the light is on you cannot turn it off by telegrams decrease brightness.</p>

Name	Object 2: CH1 – Value
Function	1 byte communication object for precise control by setting a new brightness level directly.
Description	<p>The brightness level will go up or down slowly according to the ramp speed configured.</p> <p>By default, the behavior when receiving a telegram with non-zero brightness value, when the light is turned off is turned on and regulate the level received. Also, if the light is on you can turn it off by a telegram with the value 0.</p>
Name	Object 3: CH1 - On/Off state
Function	1bit communication object for feedback signalling of the on / off state of the dimmer.
Description	<p>When the dimmer is off and receives a switch on telegram or a brightness value, a “1” is sent through this object.</p> <p>When the dimmer is on and it receives a switch off telegram or a brightness value of 0% a “0” is sent through this object.</p>
Name	Object 4: CH1 - Value state
Function	1byte communication object for feedback signalling of the current brightness level of the dimmer.
Description	When it receives a new brightness value or a increase/decrease telegram the final brightness value is sent through this object.
Name	Object 21: DMDM490140- Enable
Function	1 bit communication object to enable or disable the device control through the KNX BUS.
Description	<p>When a “0” is received through this object the device cannot be controlled by BUS telegrams (input is not disabled). When a “1” is received the device is enabled.</p> <p>By default this feature is enabled. No need to use this object to enable normal device function.</p>
Name	Object 22: Scene
Function	1byte communication object for internal scenes execution.
Description	Scenes can be programmed in the parameters window of the device. There are up to 8 scenes available.

3.5 Parameters

The parameters of the device are configured with an specific parameter dialog, do click on “open” from the parameters menu in the ETS to run it.

There are several tabs to configure different parameters depending on the type of the device selected, in this case the device that must be selected is Dimmer 1CH.

Dimmers 1CH

General Channel 1 Scenes

Device type Dimmers 1CH

Lower Limit (% Brightness) 10

Upper Limit (% Brightness) 100

Rev 2.1.2

O.K.

Some parameters can be hidden depending on the device selected or the previous configuration. The description of every parameter is shown next.

3.5.1 General

Name	Device type
Values	Dimmers 1CH, Dimmers 2CH, Dimmers 3CH, Dimmers LED RGB, Dimmers DALI node, Dimmers DMX Channel
Description	Allows to select the corresponding device that will be programmed by the application. The ETS will show or hide communications objects and parameters according to this parameter. In this case the device that must be selected is Dimmers 1CH
Name	Lower limit (% Brightness)
Values	From 0 to 100
Description	<p>It is the minimum regulation value (in percentage %) that the dimmer can reach..</p> <p>The brightness level of the dimmer will stop at the lower limit when receiving decrements by precise control telegrams (by object 2) or dimming telegrams (by object 1) and it can only be switched off with a "0" through the on/off or value objects (objects 0 and 2).</p> <p>This parameter is only a hardware limitation. The user can adjust any value from 0 to 100% but the current brightness level will be internally adjusted according to the maximum and minimum values.</p>
Name	Upper limit (% Brightness)
Values	From 0 to 100
Description	<p>It is the maximum regulation value (in percentage %) that the dimmer can reach. The brightness level of the dimmer will stop at the upper limit when receiving increments by precise control telegrams (by object 2) or dimming telegrams (by object 1).</p> <p>This parameter is only a hardware limitation. The user can adjust any value from 0 to 100% but the current brightness level will be internally adjusted according to the maximum and minimum values.</p>




The maximum and minimum limits are parameters which depend on the lamp model and technology. In order to adjust them correctly, firstly select a 0% value for the lower limit and 100% for the upper limit. Then check the operation of the lamp in order CHx << - Value >>. Finally choose the values which best fit the behavior of the lamp.

3.5.2 Channel 1/2/3

Name	Ramp time (sec)
Values	From 0 to 255
Description	<p>It is the brightness change rate measured in seconds. The brightness changes gradually when using channel 1 value or dimming communication objects.</p> <p>Typical value = 10 seconds.</p> <p>With too low values, it will be difficult for the user to get the desired value while regulating the light.</p>

3.5.3 Scenes

The DM490140 allows to configure scenes that can be executed from bus commands with the corresponding communication object (number 22). The presets of the three channels when calling a scene are configured in the following parameters tab:

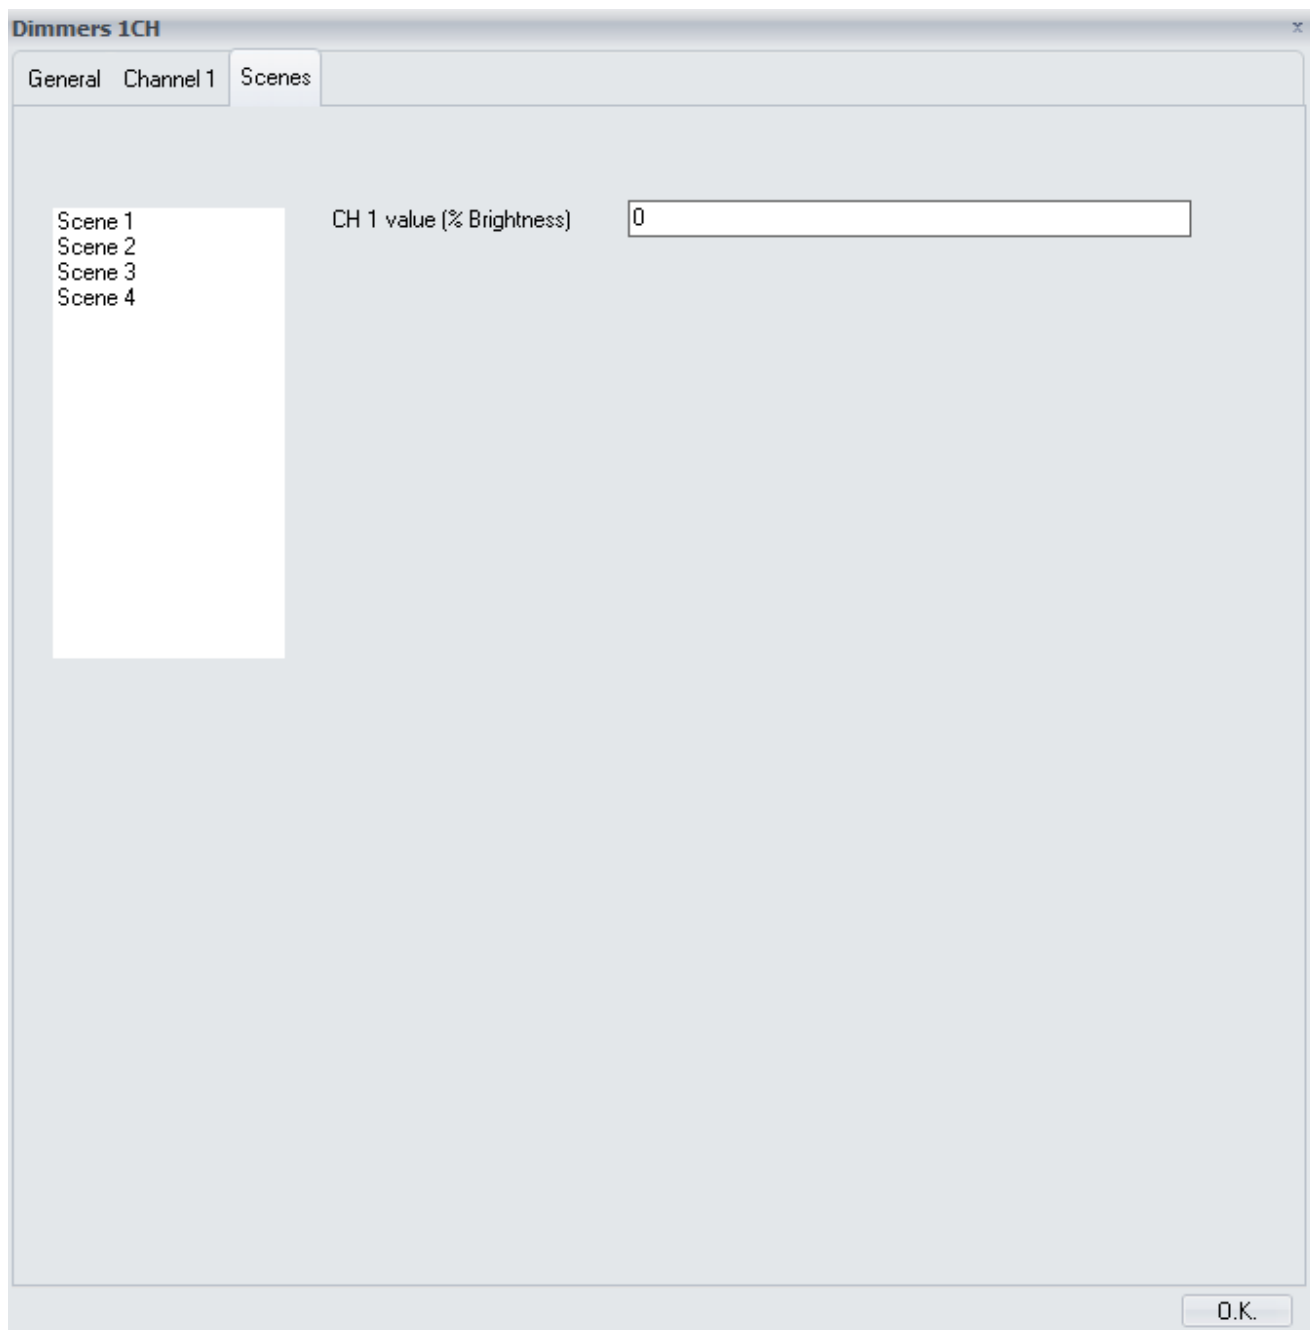


Name	Channel 1 Value (% Brightness)
Values	From 0 to 100.
Description	Channel 1 value (% brightness). It is the value memorized in the scene for the brightness level of the channel. The brightness level will go up or down slowly according to the ramp speed configured when the scene is called.
Name	Channel 1 Enable
Values	Yes/No
Description	Enable channel 1. Select if the channel is enabled (included in the scene) or not. In case of being enabled the channel will set the brightness configured in the value parameter when the scene is called.

3.6 Inputs

3.6.1 Connection

The dimmer has 1 low voltage input (SELV) that allow to control the regulation channels through pushbuttons.

The input is activated when it is connected to “reference” as shown in the next picture:

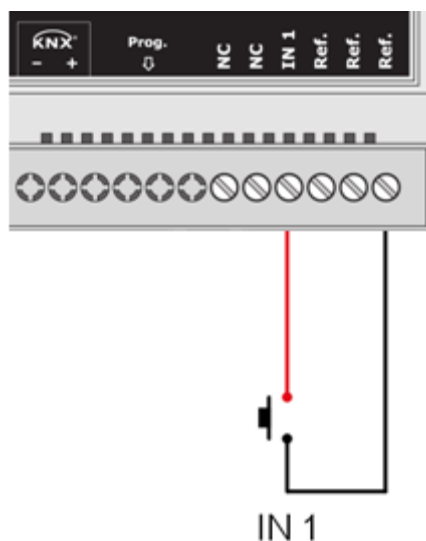

Feed low voltage lines (BUS and inputs) in separate ducting to that of power (230V) and outputs to ensure there is enough insulation and avoid interferences.

Do not connect the main voltages (230 V) or any other external voltages to any point of the BUS or inputs.

3.6.2 Working mode

The input is internally associated to its corresponding output: the input IN1 controls the output L1 (it cannot be programmed with the ETS or associated to any other function).

The working mode for the dimmer control is the classic long/short press:

- A **short press** in the input switches on and off the light completely and instantly. The switch on brightness level will be the last one and the switch off brightness level is always 0%.
- On the other side, a **long press** in the input increases or decreases the brightness slowly according to the ramp configured (if the ramp speed is very fast it will be difficult for the customer to set the brightness level desired).

4 Application notes

4.1 Light control with scenes

4.1.1 Devices

Ref. DM490140: One channel proportional actuator.

KNX 1 gang pushbutton









KNX 1 gang switch.

4.1.2 Description

The DM490140 dimmer regulates a light circuit of the room that should be controlled from a pushbuttons and also from another switch to recall two scenes directly for 30% and 70% of brightness.

The lights can be controlled from an universal pushbutton connected to the input of the DMDM490140 and at the same time from any KNX 1xgang pushbutton connected to the EIB/KNX BUS anywhere.

4.1.3 Objects links


Ref. DM490140 – 	Object 0	->		Object X Short press – KNX pushbutton
Ref. DM490140 – 	Object 1	->		Object Y Long press – KNX pushbutton
Ref. DM490140 – 	Object 22	->		Object X Rising edge – KNX switch
Ref. DM490140 – 	Object 22	->		Object Y Falling edge – KNX switch



Parameter name	Recommended setting
General	Device type Ref. DM490140/470180
	Lower limit (% Brightness) 0
	Upper limit (% Brightness) 100
Channel 1	Ramp time (seconds) 10
Scenes - Scene 0	Ch1 Value (% Brightness) 30
	Ch1 Enable/Disable Yes
Scenes – Scene 1	Ch1 Value (% Brightness) 70
	Ch1 Enable/Disable Yes
KNX Pushbutton	Short press Switch - 0/1
	Long press Increase/Decrease - 100%
KNX Switch	Rising edge Value sent = 0
	Falling edge Value sent = 1


Remember that the input of the dimmer is non-programmable and internally associated to the output. It can be controlled by any universal pushbutton (also with short-press/long-press principle).

5 Installation

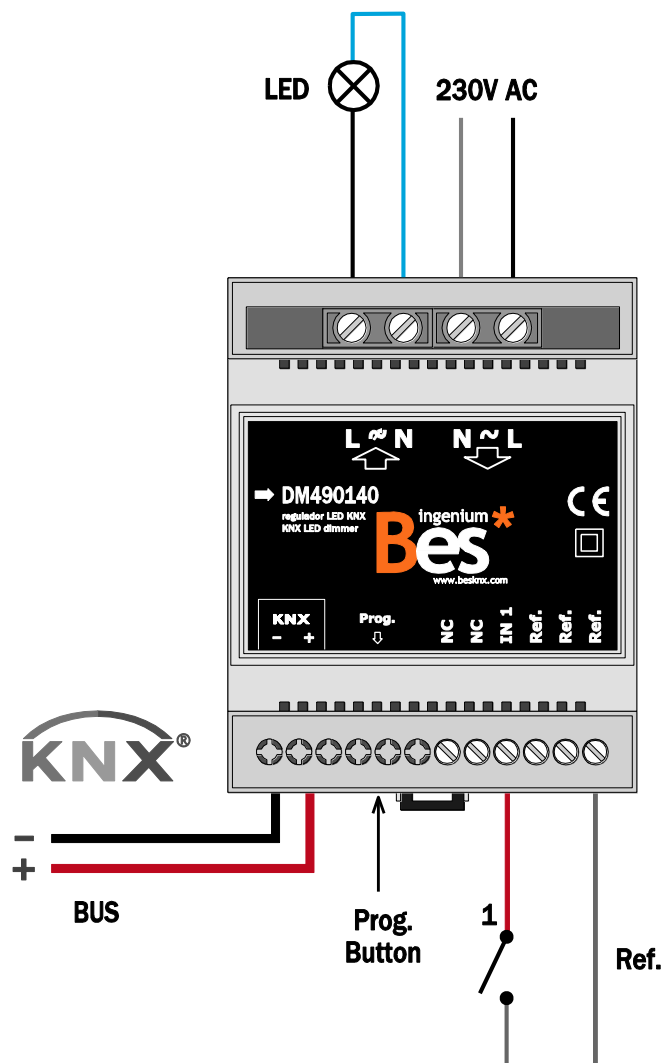

Feed low voltage lines (BUS and inputs) in ducts separate from the main power supply (230V) and outputs to ensure there is enough insulation and to avoid interference.

Do not connect mains voltage (230V) or any other external voltage at any point on the bus or inputs.

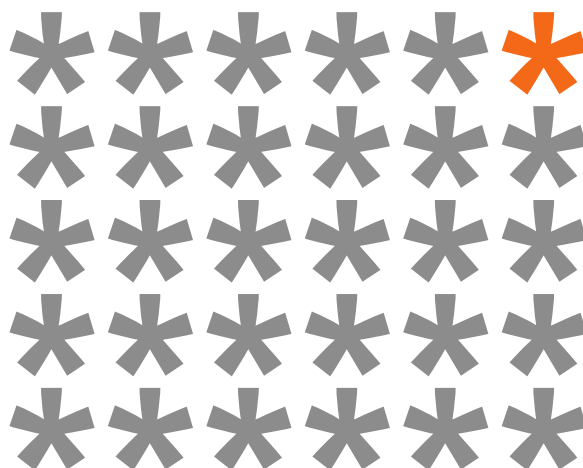

KNX products by ingenium



Výhradní distributor pro ČR a SR:

Stakohome Innovation s.r.o.

Aloisovská 934/8,
198 00 Praha 9 Hloubětín
Česká republika

Tel.: +420 226 517 522
Mob.: +420 777 780 384
info@besknx.cz
www.besknx.cz

stakohome[®]
INNOVATION

Liability limitation: The present document is subject to changes or excepted errors. The contents are continuously checked to be according to the hardware and software but deviations cannot be completely excluded. Consequently any liability for this is not accepted. Please inform us of any suggestion. Every correction will be incorporated in new versions of this manual.

Manual version: v1.0